



# ME-MW-W Series MagWeb



## Owner's Manual

## Disclaimer of Liability

The use of this manual and the conditions or methods of installation, operation, use, and maintenance of the ME-MW-W is beyond the control of Magnum Energy, Inc. Therefore, this company assumes no responsibility and expressly disclaims any liability for loss, damage, or expense whether direct, indirect, consequential, or incidental that may arise out of or be in anyway connected with such installation, operation, use, or maintenance.

Due to continuous improvements and product updates, the images shown in this manual may not exactly match the unit purchased.

## Restrictions on Use

The ME-MW-W may only be used in life-support devices or systems with the express written approval of Magnum Energy. Failure of the ME-MW-W can reasonably be expected to cause the failure of that life-support device or system, or to affect the safety or effectiveness of that device or system. If the ME-MW-W fails, it is reasonable to assume that the health of the user or other persons may be endangered.

## IMPORTANT PRODUCT SAFETY INSTRUCTIONS

This manual contains important safety instructions that must be followed during the installation and operation of this product. Read all instructions and safety information contained in this manual before installing or using this product.

- All electrical work must be performed in accordance with local, state, and federal electrical codes.
- This product is designed for indoor/compartment installation. It must not be exposed to rain, snow, moisture, or liquids of any type.
- Use insulated tools to reduce the chance of electrical shock or accidental short circuits.
- Remove all jewelry such as rings, watches, bracelets, etc., when installing or performing maintenance on the ME-MW-W and the inverter system.
- Always disconnect the batteries or energy source prior to installing or performing maintenance on the ME-MW-W and inverter system. Live power may be present at more than one point since an inverter utilizes both batteries and AC. Turning off the inverter may not reduce this risk. As long as AC power is connected, it will pass through the inverter regardless of the power switch on the inverter or the ON/OFF INVERTER push-button on the remote.

## Safety Symbols

To reduce the risk of electrical shock, fire, or other safety hazard, the following safety symbols have been placed throughout this manual to indicate dangerous and important safety instructions.



**WARNING:** This symbol indicates that failure to take a specified action could result in physical harm to the user.



**CAUTION:** This symbol indicates that failure to take a specified action could result in damage to the equipment.



**Info:** This symbol indicates information that emphasizes or supplements important points of the main text.

## Table of Contents

<b>1.0 Introduction .....</b>	<b>1</b>
<b>1.1 Product Features .....</b>	<b>1</b>
1.2 Compatibility and Measurement Channels.....	2
1.2.1 Inverter Only.....	2
1.2.2 Inverter + Remote .....	2
1.2.3 Inverter + Remote + BMK.....	2
<b>2.0 Installation.....</b>	<b>3</b>
2.1 Required Components and Tools.....	4
2.1.1 List of Supplied Components in the ME-MW-W: .....	4
2.1.2 List of Other Required Equipment and Materials: .....	4
2.1.3 Tools Required to Install the ME-MW-W: .....	4
2.2 MagWeb Wireless Device.....	4
2.2.1 Network Connection to Single Inverter.....	4
2.2.2 Network Connection with Single Inverter and Remote Control ...	5
2.2.3 Antenna Connection .....	5
2.3 MagWeb Wireless Gateway .....	5
2.3.1 Antenna Connection .....	5
2.3.2 Ethernet Connection to Local Area Network and Internet.....	5
2.3.3 Power Connection .....	6
2.4 Local Area Network Configuration.....	6
2.5 Registration on data.magnumenergy.com .....	6
<b>3.0 Using data.magnumenergy.com .....</b>	<b>6</b>
<b>4.0 Using the LED Indicator to Determine the MagWeb’s Status.....</b>	<b>7</b>
4.1 MagWeb Wireless Device.....	7
4.2 MagWeb Wireless Gateway .....	8
4.2.1 LEDs Next to Antenna.....	8
4.2.2 LEDs Above Ethernet Port .....	8
<b>5.0 Troubleshooting .....</b>	<b>9</b>
5.1 Troubleshooting Checklist.....	9
5.2 Troubleshooting Questions and Answers.....	9
<b>6.0 Specifications .....</b>	<b>11</b>
<b>7.0 Limited Warranty .....</b>	<b>12</b>
7.1 How to Receive Repair Service .....	13

## **List of Figures**

Figure 1-1, Illustration of MagWeb Device .....	1
Figure 2-1, MagWeb ME-MW-W System Diagram.....	3
Figure 4-1, MagWeb Wireless Gateway LED Diagram .....	8

## **List of Tables**

Table 4-1, MagWeb LED Indicator Guide .....	7
Table 4-2, MagWeb Wireless Gateway LEDs above Ethernet Port .....	8
Table 5-1, Troubleshooting Questions and Answers.....	9

## 1.0 Introduction


The MagWeb (ME-MW-W) is a powerful and cost effective tool for remotely monitoring Magnum brand inverters and accessories. The MagWeb installs on the Magnum network and provides live Internet monitoring of the inverter, battery monitor, and automatic generator start module. Using your always on Internet connection, the MagWeb makes live and historical conditions available to you through a web browser and our [data.magnumenergy.com](http://data.magnumenergy.com) service.

The MagWeb uses the sensors and controllers already built into Magnum products. There are no external sensors to install, configure, or calibrate.

## 1.1 Product Features

- Wireless data link from MagWeb to Internet gateway
- No sensors to install
- No configuration required
- Automatically detects connected devices
- Aids remote site management and troubleshooting

*Figure 1-1, Illustration of MagWeb Device*

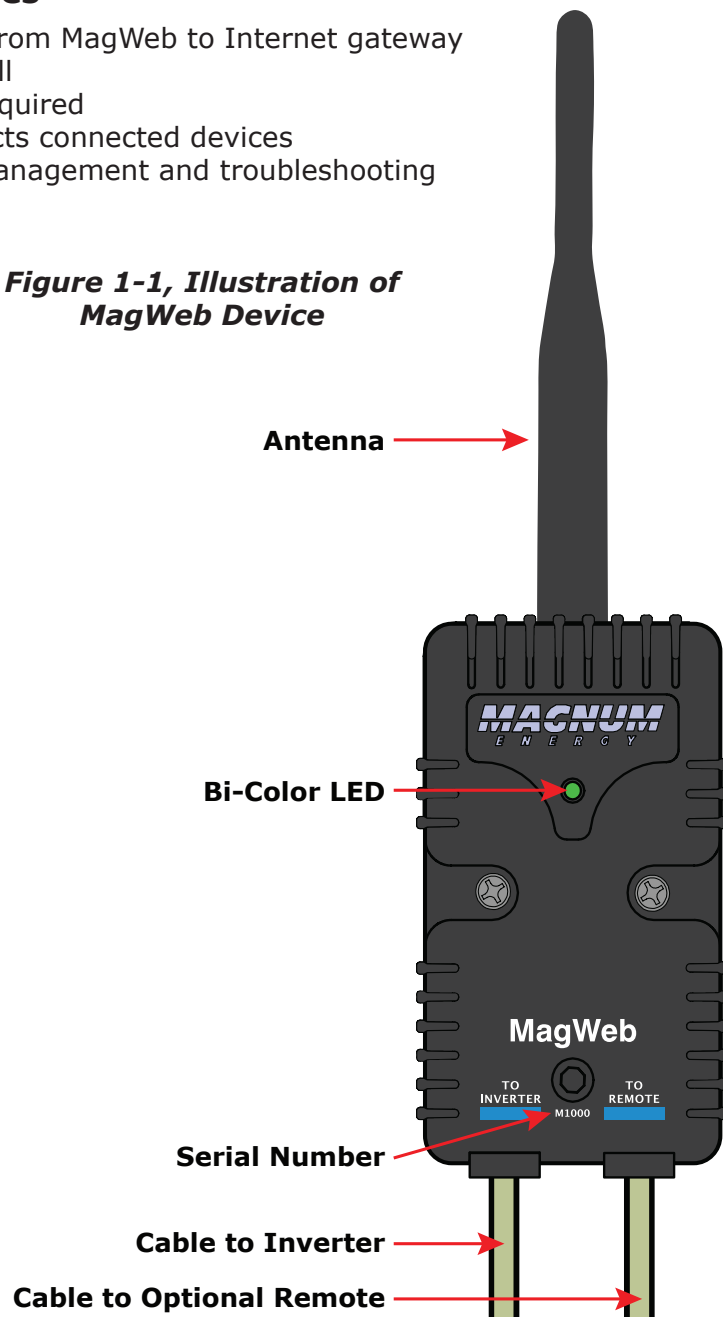

### 1.2 Compatibility and Measurement Channels



**Info:** All measurements and information are provided by the connected equipment. The MagWeb collects and transmits this information. Availability, accuracy and resolution of the measurements are dependent on the particular model(s) of Magnum equipment connected.

#### 1.2.1 Inverter Only

Compatible with all Magnum inverters with remote interface. Not all models provide all measurement channels.

- Status
- Fault(s)
- DC Volts
- DC Amps
- AC Volts in and out
- AC Amps in and out
- AC Frequency
- Invert and Charge LEDs
- Battery Temperature
- Transformer Temperature
- FET Temperature

#### 1.2.2 Inverter + Remote

Compatible with all versions of Magnum Remote Control (ME-RC50), Magnum Advanced Remote Control (ME-ARC50), and Magnum Router (ME-RTR). For PAE systems using the Magnum Router, the current MagWeb firmware will only monitor one port.

Monitored data includes all standard inverter channels plus:

- Inverter model and revision
- Inverter stack mode
- Inverter search watts
- Battery size and type
- Charger amps and AC shore amps
- Remote revision
- Low voltage (AC and DC) cutout
- Float and equalize voltages
- Absorb time
- Automatic Generator Start revision
- Battery Monitor revision

#### 1.2.3 Inverter + Remote + BMK

All inverter and remote channels and:

- State of Charge
- DC Volts
- DC Amps
- DC Volts minimum and maximum
- Amp hours in and out
- Amp hour trip meter

## 2.0 Installation


Before installing the MagWeb device, read this entire section so you can thoroughly plan the details to ensure the overall system requirements are accomplished. To assist in the planning and designing of your installation, review the basic system diagram in Figure 2-1.



**Info:** Installations should be performed by qualified personnel, such as a licensed or certified electrician. It is the installer's responsibility to determine which safety codes apply and to ensure that all applicable installation requirements are followed. Applicable installation codes vary depending on the specific location and application.

The MagWeb device is connected to the inverter using the supplied four conductor communications cable. If an ME-RC50, ME-ARC50, ME-RTR, or other remote is installed in the system, it is connected to the MagWeb device. Power is supplied to the MagWeb device from the Magnum inverter or ME-RTR.

The ME-MW-W, or MagWeb wireless device, requires a nearby ME-MW-W wireless gateway to connect to your Ethernet network and the Internet. This device is plugged into a wired Ethernet connection using the supplied Ethernet cable. Power is supplied by an included AC to DC wall adapter.

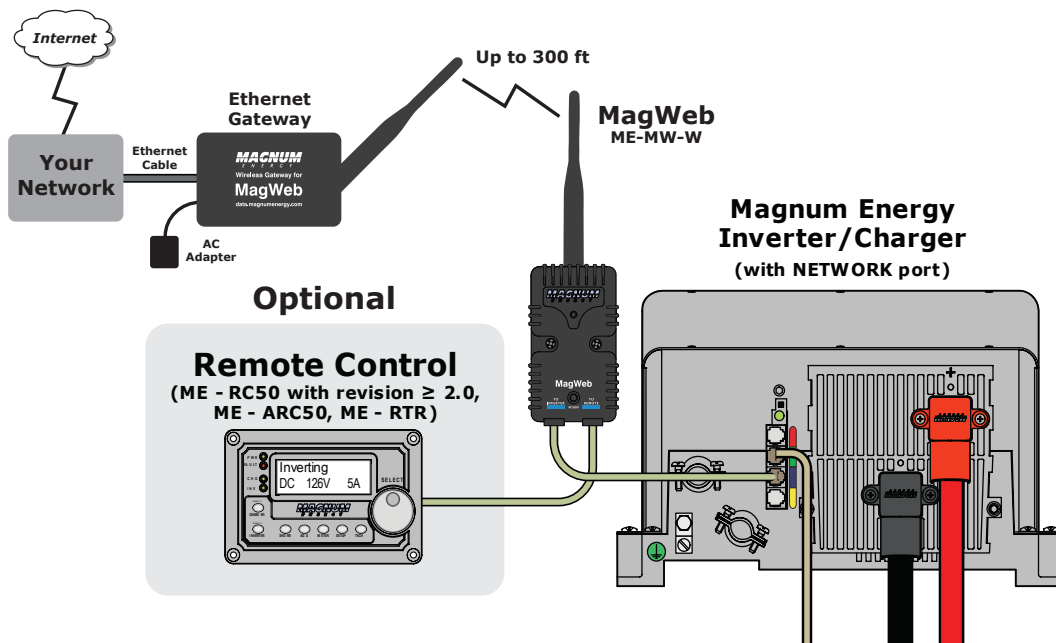

**Figure 2-1, MagWeb ME-MW-W System Diagram**

### 2.1 Required Components and Tools

#### 2.1.1 List of Supplied Components in the ME-MW-W:

- ME-MW-W Owner's Manual
- ME-MW-W MagWeb wireless device (with two #8 x 3/4" Phillips mounting screws)
- ME-MW-W MagWeb wireless gateway
- 10ft four conductor communications cable
- 10ft eight conductor CAT5E ethernet cable
- AC to DC adapter for MagWeb wireless gateway
- 2.4 GHz rubber duck antennas for MagWeb wireless device and MagWeb wireless gateway

#### 2.1.2 List of Other Required Equipment and Materials:

- Magnum inverter with a network port
- Always on Internet connection
  - that can support 2.5 megabytes per day outgoing data
  - that allows connection to public internet host

#### 2.1.3 Tools Required to Install the ME-MW-W:

- #2 Phillips screwdriver

### 2.2 MagWeb Wireless Device

Select a location that is dry and away from extreme temperatures to mount the ME-MW-W MagWeb wireless device. Use the two supplied #8 x 3/4" screws to securely affix the module. Allow ample room to view the LED on the MagWeb wireless device, access the two RJ11 ports, and connect the antenna. Unless the MagWeb wireless gateway will be located in the same room, you must keep the MagWeb wireless device antenna outside of a metallic enclosure or compartment.



**CAUTION:** Do not mount the ME-MW-W MagWeb wireless device in a closed battery compartment, or in an area where water or any other liquid can enter the device and cause shorting or corrosion. Failure due to improper mounting is not covered by the warranty.



**CAUTION:** Before beginning the installation, ensure all AC power is disconnected from the inverter, and all battery supply cables are disconnected from the battery bank or switched off with an appropriately rated circuit breaker. There should be no flashing or lit LEDs on the Magnum inverter or any accessories.

#### 2.2.1 Network Connection to Single Inverter

Use the supplied four conductor communications cable to connect the ME-MW-W MagWeb device port marked "INVERTER" to port marked "REMOTE" on the Magnum inverter.

### 2.2.2 Network Connection with Single Inverter and Remote Control

The ME-MW-W MagWeb wireless device, using supplied cable, can be near the remote or near the inverter. To mount the MagWeb wireless device near the inverter, use the supplied four conductor cable from the inverter "REMOTE" port to the MagWeb wireless device "INVERTER" port. Use the longer cable supplied with the remote control to run from the MagWeb wireless device "REMOTE" port to the remote control.

### 2.2.3 Antenna Connection

Attach one of the supplied rubber duck antennas to the antenna port on top of the ME-MW-W MagWeb wireless device. Tighten finger tight. In high vibration environments, a very small amount of low strength thread locking compound may be used.

## 2.3 MagWeb Wireless Gateway

Select a location that is dry and away from extreme temperatures to place the ME-MW-W MagWeb wireless gateway. Allow room to view the LEDs on both ends and affix with the cables without kinks or sharp bends. Unless the MagWeb wireless device will be located in the same room, you must keep the MagWeb wireless gateway antenna outside of a metallic enclosure or compartment. For best range, the MagWeb wireless gateway and antenna should be mounted clear of obstructions and as high as possible.



**CAUTION:** Do not mount the ME-MW-W MagWeb wireless gateway in a closed battery compartment, or in an area where water or any other liquid can enter the device and cause shorting or corrosion. This failure is not covered by the warranty.

### 2.3.1 Antenna Connection

Attach one of the supplied rubber duck antennas to the antenna port on top of the ME-MW-W MagWeb wireless device. Tighten finger tight. In high vibration environments, a very small amount of low strength thread lock may be used.

### 2.3.2 Ethernet Connection to Local Area Network and Internet

The ME-MW-W MagWeb wireless gateway should be attached to the Local Area Network (LAN) / Ethernet network using the supplied eight conductor CAT5E patch cord. This connection may be made directly to a network access device such as a router, or it may be through a wall jack that connects to a network access device. In all cases, the total length of Ethernet cable run is limited to 100 meters. The Ethernet cable must be connected to the Ethernet network before the MagWeb wireless gateway is powered up.

### 2.3.3 Power Connection

The ME-MW-W MagWeb wireless gateway is powered by the provided AC to DC adapter. Plug adapter into wireless gateway and then a 120 VAC outlet.

Alternatively, you may power the wireless gateway from a 7 to 36 volt DC power source capable of supplying 2 watts. You will need to supply a fused 2.1 x 5.5mm power cable. The center conductor is positive and the outer conductor is negative.

### 2.4 Local Area Network Configuration

The MagWeb wireless gateway communicates with Magnum Energy's servers by establishing an outgoing TCP/IP connection when data is received. At the default 30 second data interval, the MagWeb will send approximately 2.5 megabytes of data per day.

By default, the MagWeb wireless gateway determines network configuration using DHCP or BOOTP. This information includes the MagWeb wireless gateway's LAN IP address and router IP address. Most networks provide DHCP service and therefore the MagWeb wireless gateway usually does not require any configuration.

For details on configuring the MagWeb wireless gateway for non-DHCP networks or special configuration, consult the troubleshooting section of this manual.

### 2.5 Registration on [data.magnumenergy.com](http://data.magnumenergy.com)

Visit <http://data.magnumenergy.com/> for up to date instructions on web.

### 3.0 Using [data.magnumenergy.com](http://data.magnumenergy.com)

Instructions for viewing data from your MagWeb device is available at <http://data.magnumenergy.com/>.

#### 4.0 Using the LED Indicator to Determine the MagWeb's Status

There is a bi-color LED indicator on the front of the MagWeb device to indicate the battery monitor's status. When the MagWeb device is first powered up, the LED blinks red and green while going through a self-test. Once the self-test is complete, use the table below and the LED indicator on your MagWeb device to determine the MagWeb's operating status.

If the MagWeb device does not function correctly, use Table 4.1 to help find a solution.

#### 4.1 MagWeb Wireless Device

**Table 4-1, MagWeb LED Indicator Guide**

LED Status	Meaning
OFF	Ensure the cables are correctly seated into the MagWeb device.
<b>Red ON, Green ON, Red On, Green ON</b>	Power-up sequence (1 second interval between each color). The MagWeb device is performing a self-test – this occurs when first connected to power.
<b>Green ON</b>	Normal operation: the MagWeb device is correctly transmitting and receiving with network devices.
<b>Green BLINKING</b>	Not able to communicate with remote display. A. If the remote/router display is off; refer to the remote/router owner's manual for troubleshooting. Ensure the inverter is on and the correct communication cable is connected to the REMOTE port on the inverter. B. If the ME-RC50 remote display is on; ensure the remote display is revision 2.0 or higher. RC50 remote displays with revisions prior to 2.0 are not compatible with the ME-MW-W.
<b>Red ON</b>	The power-up sequence failed. Contact Magnum.
<b>Red BLINKING</b>	No communication, or an unrecognizable communication on the network. Check the communication cable; ensure it is connected correctly. Important: Ensure the RJ11 connectors are pushed into the correct port; you should feel/hear a "click" when the connection is made.

## 4.2 MagWeb Wireless Gateway

### 4.2.1 LEDs Next to Antenna

In normal operation, the yellow LED will blink to indicate reception of data. With a single MagWeb, this LED should blink once every 30 seconds. In normal operation, the green LED will not blink. If the yellow LED never blinks and no data is showing on [data.magnumenergy.com](http://data.magnumenergy.com), then consult the troubleshooting guide.

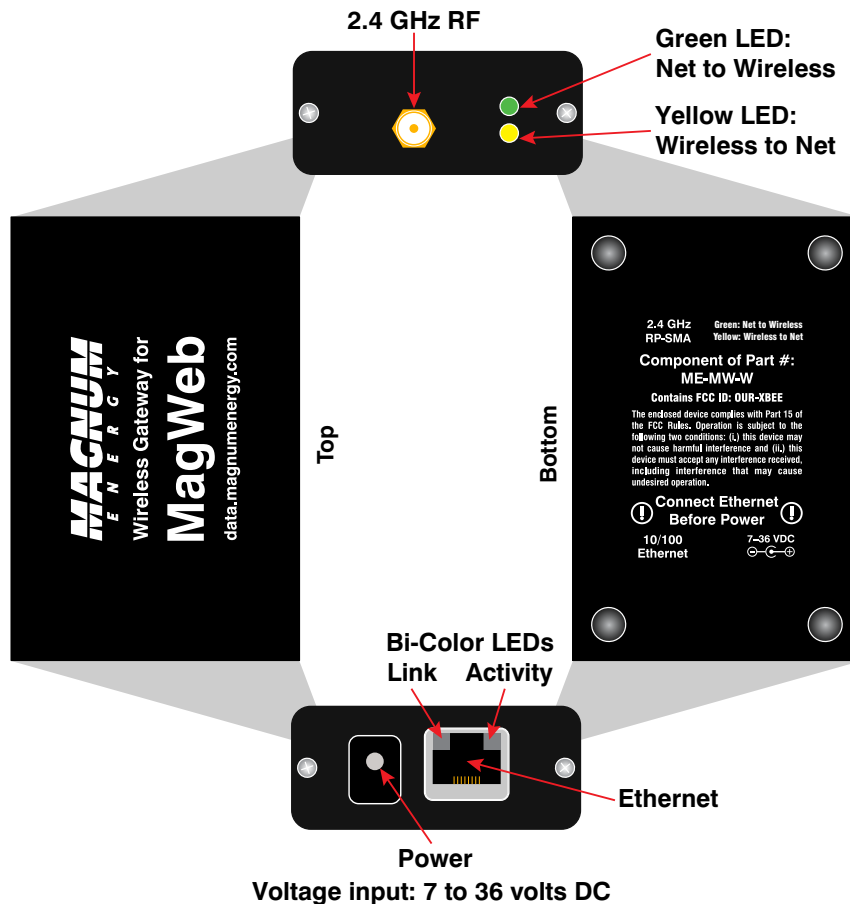


Figure 4-1, MagWeb Wireless Gateway LED Diagram

### 4.2.2 LEDs Above Ethernet Port

Normal operation is Amber or Green for LINK LED and periodically flashing.

Table 4-2, Functions of MagWeb Wireless Gateway LEDs above Ethernet Port

Link LED – Left Side	
Color	Meaning
Off	No Link
Amber	10 Mbps
Green	100 Mbps

Link LED – Right Side	
Color	Meaning
Off	No Activity
Amber	Half Duplex
Green	Full Duplex

## 5.0 Troubleshooting



**Info:** Before using the information below to troubleshoot, review Tables 4-1 and 4-2, LED Indicator Guides.

### 5.1 Troubleshooting Checklist

The MagWeb is designed to be simple to install and easy to use. Most issues will arise when a minor hook-up problem exists. Check the following items before seeking further help:

- Is the MagWeb wireless gateway connected to an always on internet connection?
- Did you connect the wireless gateway's Ethernet cable before turning the power on?
- Is it attached to a DHCP network to assign the address?
- Did you plug it into a laptop to test?
- Is the power supply properly attached and plugged into a viable outlet?
- Are the antennas securely attached to the MagWeb device and the wireless gateway?
- Did you refer to Tables 4-1 and 4-2 to learn what the LED signals were communicating to you?

### 5.2 Troubleshooting Questions and Answers

*What is this device on my network?*

The MagWeb device allows remote monitoring of Magnum Energy inverters and accessories. Physically, it is a small black box with ethernet cable, wireless antenna, power adapter, and four LEDs.

*How does it communicate?*

When the first wireless data is received from the MagWeb, the gateway will open a TCP/IP connection to Magnum Energy's data server. This connection requires very little bandwidth — about 2.5 megabytes per day.

*Why can't I see my device on [data.magnumenergy.com](http://data.magnumenergy.com)?*

The most likely cause is an insufficiently strong wireless signal from the MagWeb. The recommended maximum distance between the MagWeb and the wireless gateway is 300 feet. (This distance may be greater in open spaces or less where obstructions exist.)

*How can I improve wireless performance?*

- Make sure the MagWeb device's antenna is tightly connected.
- Make sure the wireless gateway's antenna is tightly connected.
- Move the MagWeb device and wireless gateway closer together.

## Troubleshooting

*How can I check the wireless gateway for data reception?*

In addition to checking for data on <http://data.magnumenergy.com>, you can watch the yellow LED on the wireless gateway to check for data reception. You should see the yellow LED flash faintly every 30 seconds. (See Figure 4.1)

*I am a network administrator. How do I adjust network settings?*

For most applications, you do not need to adjust network settings. The MagWeb wireless gateway will automatically receive its network settings using DHCP or BOOTP.

If you need to modify any settings, you may telnet to the device on port 9999.

*How can I make sure my wireless gateway is connected to the internet?*


Unplug ethernet cable from the MagWeb Wireless Gateway and plug it into your laptop computer. Make sure wireless and cell phone network connections are turned off.

Verify that you can reboot your computer and then use a web browser to visit <http://data.magnumenergy.com/>. If you cannot, then the network connection will not work for the gateway. The most likely problem is a network log-in requirement or a firewall that does not allow outgoing data connections.

*What if I still have questions?*

Visit [www.magnumenergy.com](http://www.magnumenergy.com) or call Magnum Energy at 425-353-8833.

## 6.0 Specifications

<b>Sample Rate</b>	
Fixed 30 second sample interval	
2,800 measurements per day	
<b>Communication - 802.15.4 XBee Wireless</b>	
For use with our <a href="http://data.magnumenergy.com">data.magnumenergy.com</a> service	
<b>US Version:</b> 2.4 GHz, 63 mW (+18 dBm)	(300' indoor range, 1 mile outdoor range)
<b>International Version:</b> 2.4 GHz, 10 mW (+10 dBm)	(200' indoor range, 2,500' outdoor range; special order)
<b>Low Power Version:</b> 2.4 GHz, 1 mW (+0 dBm)	(100' indoor range, 300' outdoor range; special order)
Direct Sequence Spread Spectrum (DSSS)	
RP-SMA connector and included rubber duck antenna	
Requires 802.15.4 XBee to Ethernet wireless gateway	
<b>Wireless Agency Approvals:</b>	
<ul style="list-style-type: none"> <li>▪ United States (FCC Part 15.247)</li> <li>▪ Industry Canada (IC)</li> <li>▪ Europe (CE)</li> <li>▪ Japan</li> <li>▪ Australia</li> </ul>	
<b>Power Draw</b>	
<b>MagWeb</b>	<b>Wireless Gateway</b>
< 0.1 watts average from Magnum bus	< 4 watts average from 120 VAC
<b>Materials</b>	
<b>MagWeb Case</b>	<b>Wireless Gateway Case</b>
Plastic	Anodized aluminum
 All parts are RoHS compliant, no lead used in manufacture	
<b>Weight and Dimensions</b>	
<b>Shipping Weight:</b> 3 pounds	
<b>Kit Includes</b>	
<b>MagWeb 802.15.4</b>	<b>Wireless 802.15.4 Gateway</b>
<ul style="list-style-type: none"> <li>▪ Manual</li> <li>▪ Communications Cable (4-conductor, 10' twisted pair, telephone standard)</li> <li>▪ Mounting Screws</li> <li>▪ Antenna</li> </ul>	<ul style="list-style-type: none"> <li>▪ Antenna</li> <li>▪ Ethernet Cable, 10'</li> <li>▪ AC Adapter, Energy Star, North American Plug</li> </ul>
<b>Remote Requirements</b>	
ME-RC50, ME-ARC50 or ME-RTR are required when monitoring device(s) other than inverter	

### 7.0 Limited Warranty

Magnum Energy, Inc., warrants the ME-MW-W MagWeb device to be free from defects in material and workmanship that result in product failure during normal usage, according to the following terms and conditions:

1. The limited warranty for this product extends for 12 months from the product's original date of purchase.
2. The limited warranty extends to the original purchaser of the product and is not assignable or transferable to any subsequent purchaser.
3. During the limited warranty period, Magnum Energy will repair, or replace at Magnum Energy's option, any defective parts, or any parts that will not properly operate for their intended use with factory new or remanufactured replacement items if such repair or replacement is needed because of product malfunction or failure during normal usage. The limited warranty does not cover defects in appearance, cosmetic, decorative or structural parts or any non-operative parts. Magnum Energy's limit of liability under the limited warranty shall be the actual cash value of the product at the time the original purchaser returns the product for repair, determined by the price paid by the original purchaser. Magnum Energy shall not be liable for any other losses or damages.
4. Upon request from Magnum Energy, the original purchaser must prove the product's original date of purchase by a dated bill of sale, itemized receipt.
5. The original purchaser shall return the product prepaid to Magnum Energy in Everett, WA. After the completion of service under this limited warranty, Magnum Energy will return the product prepaid to the original purchaser via a Magnum-selected non-expedited surface freight within the contiguous United States and Canada; this excludes Alaska and Hawaii.
6. If Magnum repairs or replaces a product (with either a new or remanufactured product), its warranty continues for the remaining portion of the original warranty period or 90 days from the date of the return shipment to the original purchaser, whichever is greater. All replaced products and parts removed from repaired products become the property of Magnum Energy.
7. This limited warranty is voided if:
  - the product has been modified without authorization
  - the serial number has been altered or removed
  - the product has been damaged through abuse, neglect, accident, high voltage or corrosion
  - the product was not installed and operated according to the owner's manual

**BEFORE RETURNING ANY UNIT, CONTACT MAGNUM ENERGY FOR A RETURN MATERIAL AUTHORIZATION (RMA) NUMBER.**

## 7.1 How to Receive Repair Service

If your Product requires warranty service or repair, contact either:

1. An Authorized Service Center, which are listed on the Magnum Energy Website at <http://www.magnumenergy.com/ServiceCenters.htm>, or
2. Magnum Energy, Inc. at:
  - Telephone: 425-353-8833
  - Fax: 425-353-8390
  - Email: [warranty@magnumenergy.com](mailto:warranty@magnumenergy.com)

If returning your Product directly to Magnum Energy for repair, you must:

- return the unit in the original, or equivalent, shipping container
- receive a Return Materials Authorization (RMA) number from the factory prior to the return of the Product to Magnum Energy for repair
- place RMA numbers clearly on the shipping container or on the packing slip

When sending your Product for service, please ensure it is properly packaged. **Damage due to inadequate packaging is not covered under warranty.** We recommend sending the Product by traceable or insured service.



Magnum Energy, Inc.  
2211 West Casino Rd.  
Everett, WA 98204  
Phone: (425) 353-8833  
Fax: (425) 353-8390  
Web: [www.magnumenergy.com](http://www.magnumenergy.com)